

VTA-4




AKKUMULERINGSTANK

KAPACITET
400-10000 liter

MAKS. ARBEJDSTRYK
3 bar 95° C



VTA-4

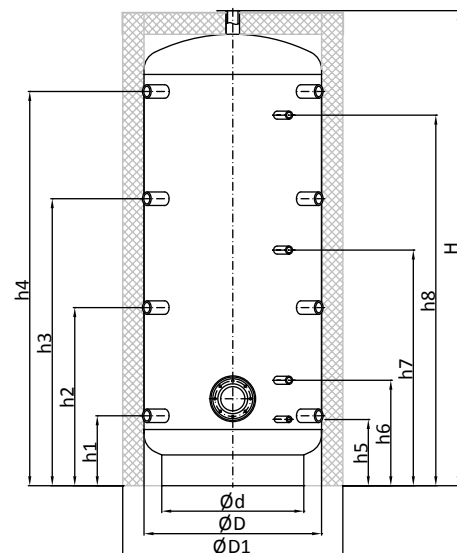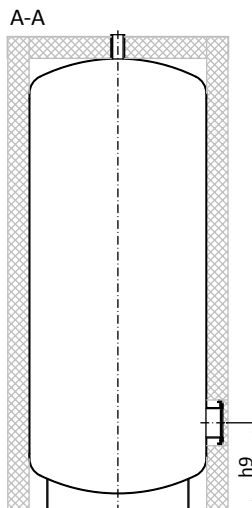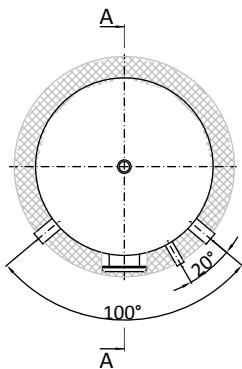

- H, h1-h3 Monteringsrør til fremløb og returløbninger af varmekredse
 h5 Teknologisk monteringsrør
 h6-h8 Monteringsrør til temperaturfølere
 h9 Flange Ø 120mm

V _{tank} / l	Overordnede dimensioner, mm				Tilkoblingsdimensioner, mm								
	H	ØD1	ØD	Ød	h1	h2	h3	h4	h5	h6	h7	h8	h9
500	1995	800	600	450	264	721	1181	1634	249	414	964	1534	336
	1½"				1½"			½"	¾"				
1000	2060	1050	850	700	323	780	1240	1693	308	473	1023	1593	395
	1½"				1½"			½"	¾"				
1500	2150	1200	1000	850	368	825	1285	1738	353	518	1068	1638	440
	1½"				1½"			½"	¾"				
2000	2250	1400	1200	1000	419	876	1336	1789	404	569	1119	1689	491
	1½"				1½"			½"	¾"				
3000	2340	1600	1400	1150	465	876	1336	1789	404	569	1119	1689	537
	2"				2"			½"	¾"				

Forespørg på dimensioner/priser for tank-kapacitet på 400/750 og 4000-10000 liter.



Passat Energy ApS • Industrivej 24 • 8830 Tjele
 Telefon: +45 86 65 21 00
 Mail: passatenergy@gmail.com • www.passatenergy.com

Forhandler